
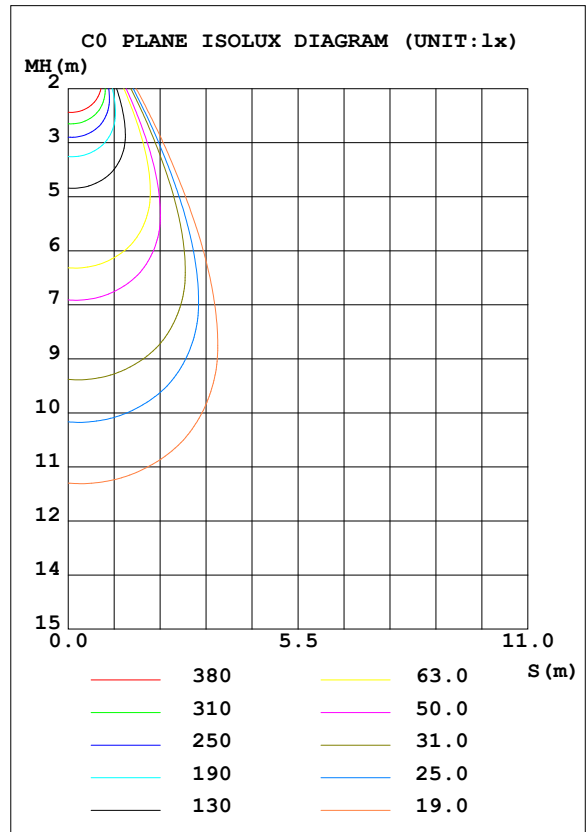


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:32.970V I:0.5000A P:16.485W PF:1.0000 Freq:0Hz Lamp Flux:1475.17x1 lm		
NAME: XDL E4-WRA-L39030-50DW	TYPE:Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ108mm*H154mm	
MFR.: SBC XICATO CORP.		

DATA OF LAMP		PHOTOMETRIC DATA Eff: 89.49 lm/W			
MODEL	XOB CRI 90 3000K	I <sub>max</sub> (cd)	2518	S/MH (C0/180)	0.64
NOMINAL POWER (W)	18	LOR (%)	100.0	S/MH (C90/270)	0.73
RATED VOLTAGE (V)	36	TOTAL FLUX (lm)	1475.2	η UP, DN (C0-180)	0.0, 54.0
NOMINAL FLUX (lm)	1475.17	CIE CLASS	DIRECT	η UP, DN (C180-360)	0.0, 46.0
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.50
TEST VOLTAGE (V)	33.4	η down (%)	100.0	CIBSE SHR MAX	0.70

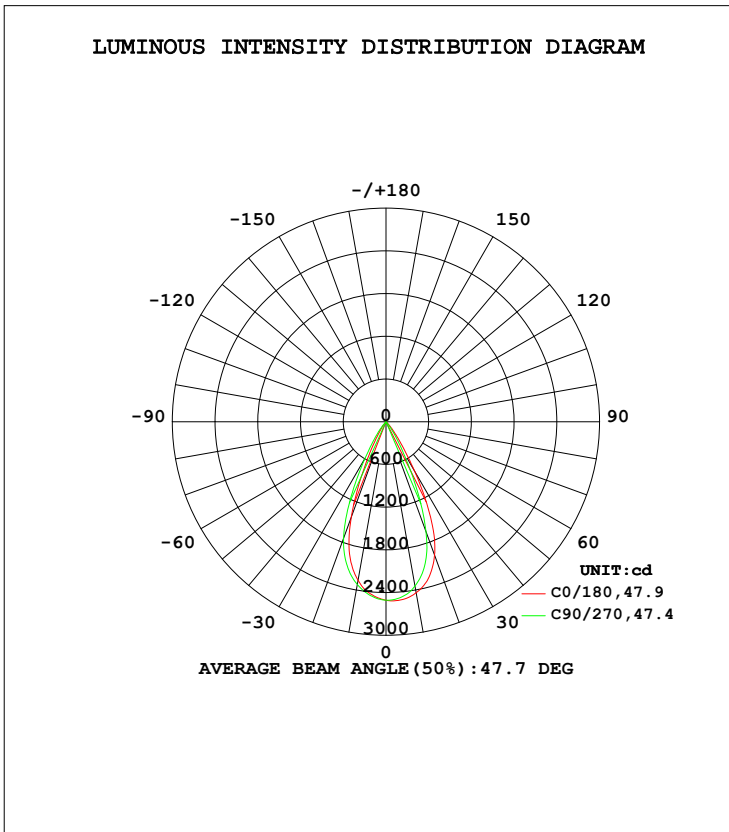

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature: 25.3DEG  
 Operators: Jasoan  
 Test Date: 2024-05-22

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System: EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
 Humidity: 58%  
 Test Distance: 9.016m [K=1.0000]  
 Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C90	C180	C270					γ	Φ zone	Φ total	%lum, lamp
10	2439	2343	2262	2322					0- 10	231.6	231.6	15.7,15.7
20	1995	1644	1429	1746					10- 20	580.4	812.0	55,55
30	813.9	438.4	304.6	576.8					20- 30	494.1	1306	88.5,88.5
40	136.4	49.36	23.23	91.30					30- 40	147.9	1454	98.6,98.6
50	10.22	1.591	1.004	4.006					40- 50	19.66	1474	99.9,99.9
60	0.7194	0.4129	0.2919	0.5473					50- 60	1.157	1475	100,100
70	0.1533	0.0762	0.0445	0.0765					60- 70	0.2446	1475	100,100
80	0.0509	0.0445	0.0445	0.0445					70- 80	0.0595	1475	100,100
90	0.0509	0.0445	0.0445	0.0445					80- 90	0.0503	1475	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd								UNIT:lm			

Conical surface Flux(90deg): 1469.6 lm

%lum = 99.6%  
 %lamp = 99.6%

Conical surface Flux(120deg): 1474.8 lm


%lum = 100.0%  
 %lamp = 100.0%

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2024-05-22

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
 Humidity:58%  
 Test Distance:9.016m [K=1.0000]  
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:32.970V I:0.5000A P:16.485W PF:1.0000 Freq:0Hz Lamp Flux:1475.17x1 lm		
NAME: XDL E4-WRA-L39030-50DW	TYPE:Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ108mm*H154mm	
MFR.: SBC XICATO CORP.		

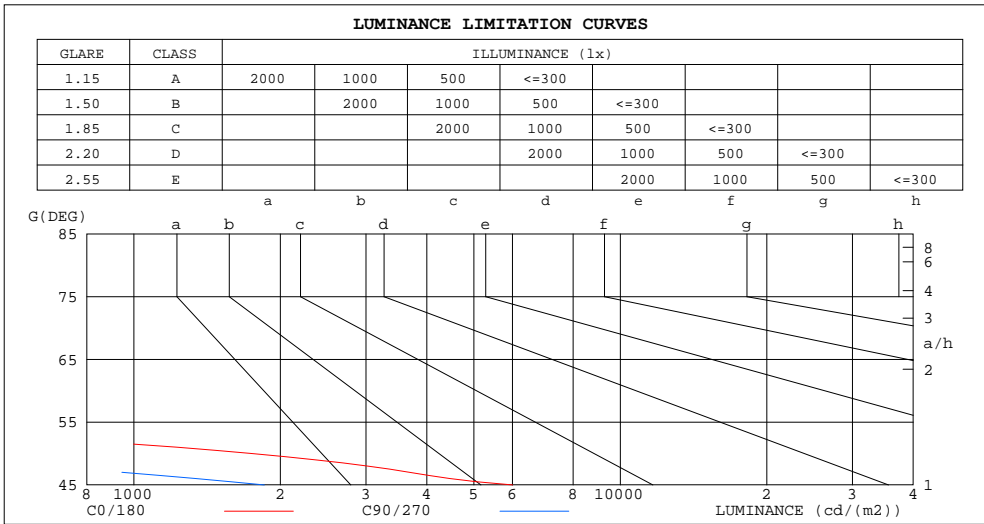

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	64	56
80	32	28
75	32	19
70	49	24
65	102	44
60	157	90
55	243	145
50	1737	270
45	6004	1854


C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature: 25.3DEG  
 Operators: Jasoan  
 Test Date: 2024-05-22

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System: EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
 Humidity: 58%  
 Test Distance: 9.016m [K=1.0000]  
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:32.970V I:0.5000A P:16.485W PF:1.0000 Freq:0Hz Lamp Flux:1475.17x1 lm		
NAME: XDL E4-WRA-L39030-50DW	TYPE:Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ108mm*H154mm	
MFR.: SBC XICATO CORP.		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															
	Coefficients of Utilization(CU)															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.10	1.08	1.10	1.08	1.06	1.06	1.04	1.03	1.02	1.01	.00	.99	.98	.97	.95
2.0	1.05	1.02	.99	1.04	1.00	.98	1.00	.98	.96	.97	.95	.94	.95	.93	.92	.90
3.0	.99	.95	.92	.98	.94	.91	.96	.92	.90	.93	.90	.88	.91	.89	.87	.85
4.0	.94	.89	.86	.93	.89	.85	.91	.87	.84	.89	.86	.83	.87	.85	.82	.81
5.0	.89	.84	.81	.88	.84	.80	.87	.83	.80	.85	.82	.79	.84	.81	.78	.77
6.0	.85	.80	.76	.84	.79	.76	.83	.79	.75	.81	.78	.75	.80	.77	.74	.73
7.0	.81	.76	.72	.80	.75	.72	.79	.75	.72	.78	.74	.71	.77	.73	.71	.70
8.0	.77	.72	.68	.77	.72	.68	.76	.71	.68	.75	.71	.68	.74	.70	.67	.66
9.0	.74	.69	.65	.73	.68	.65	.72	.68	.65	.72	.68	.65	.71	.67	.64	.63
10.0	.70	.65	.62	.70	.65	.62	.69	.65	.62	.69	.65	.62	.68	.64	.62	.60

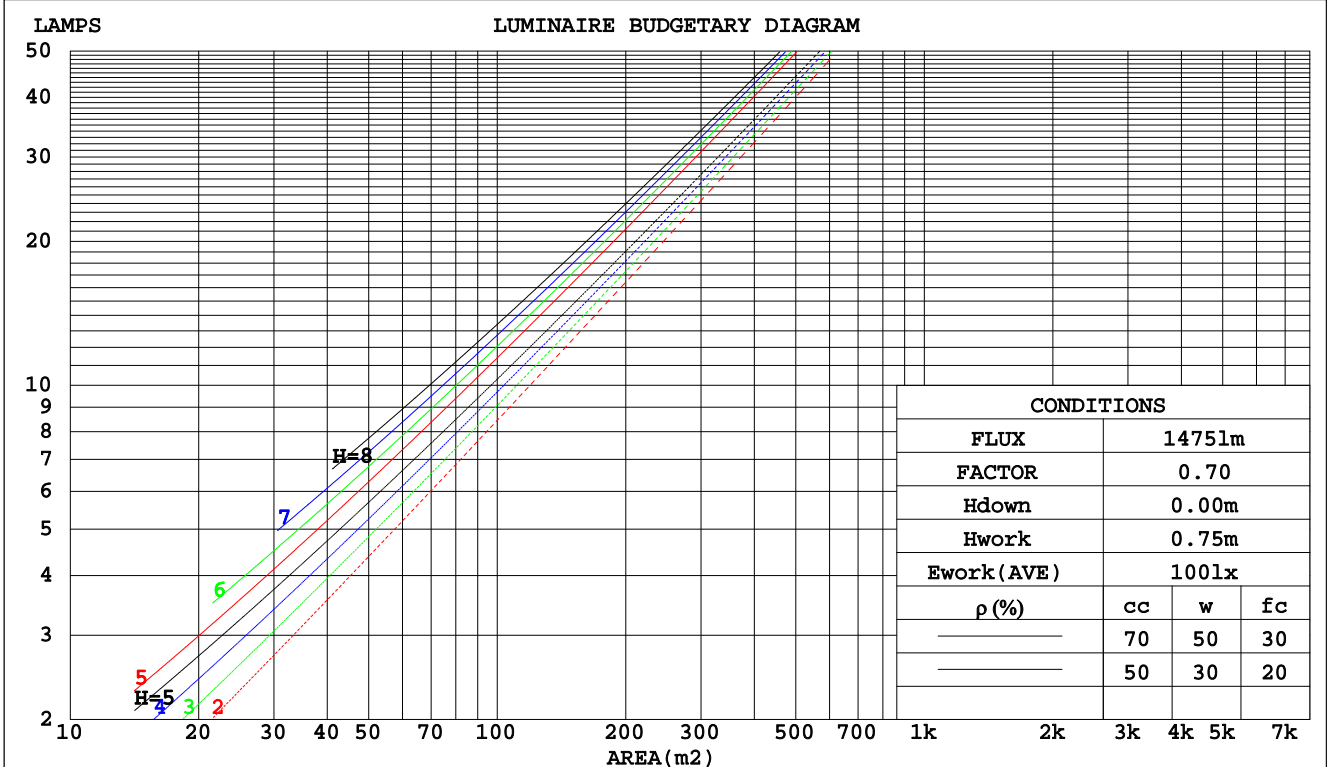

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature: 25.3DEG  
 Operators: Jasoan  
 Test Date: 2024-05-22

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System: EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
 Humidity: 58%  
 Test Distance: 9.016m [K=1.0000]  
 Remarks:

WEC AND CCEC

Test:U:32.970V I:0.5000A P:16.485W PF:1.0000 Freq:0Hz Lamp Flux:1475.17x1 lm		
NAME: XDL E4-WRA-L39030-50DW	TYPE:Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ108mm*H154mm	
MFR.: SBC XICATO CORP.		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.158	.090	.028	.151	.086	.027	.139	.080	.025	.127	.074	.024	.117	.068	.022	
2.0	.149	.082	.025	.144	.079	.024	.133	.074	.023	.124	.069	.022	.115	.065	.020	
3.0	.141	.075	.023	.137	.073	.022	.128	.069	.021	.120	.066	.020	.112	.062	.019	
4.0	.134	.070	.020	.130	.068	.020	.123	.065	.019	.116	.062	.019	.109	.059	.018	
5.0	.128	.065	.019	.124	.064	.019	.118	.061	.018	.112	.059	.018	.106	.057	.017	
6.0	.122	.061	.018	.119	.060	.017	.113	.058	.017	.108	.056	.016	.103	.054	.016	
7.0	.117	.058	.016	.114	.057	.016	.109	.055	.016	.104	.054	.016	.100	.052	.015	
8.0	.112	.055	.015	.110	.054	.015	.105	.053	.015	.101	.051	.015	.097	.050	.015	
9.0	.108	.052	.015	.105	.051	.014	.102	.050	.014	.098	.049	.014	.094	.048	.014	
10.0	.103	.050	.014	.102	.049	.014	.098	.048	.014	.095	.047	.013	.092	.046	.013	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.170	.157	.146	.145	.135	.126	.099	.093	.087	.057	.054	.051	.018	.017	.016	
2.0	.153	.133	.115	.131	.114	.100	.090	.079	.069	.052	.046	.041	.017	.015	.013	
3.0	.140	.113	.092	.120	.098	.080	.082	.068	.056	.047	.040	.033	.015	.013	.011	
4.0	.129	.098	.075	.110	.085	.066	.076	.059	.046	.044	.035	.027	.014	.011	.009	
5.0	.119	.087	.062	.102	.075	.054	.070	.052	.038	.041	.031	.023	.013	.010	.007	
6.0	.111	.077	.052	.096	.067	.046	.066	.047	.032	.038	.027	.019	.012	.009	.006	
7.0	.104	.069	.044	.090	.060	.039	.062	.042	.027	.036	.025	.016	.012	.008	.005	
8.0	.099	.063	.038	.085	.054	.033	.059	.038	.024	.034	.023	.014	.011	.007	.005	
9.0	.093	.057	.033	.080	.050	.029	.056	.035	.020	.032	.021	.012	.011	.007	.004	
10.0	.089	.053	.029	.077	.046	.025	.053	.032	.018	.031	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2024-05-22

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
 Humidity:58%  
 Test Distance:9.016m [K=1.0000]  
 Remarks:

UGR(Unified Glare Rating) Table

Test:U:32.970V I:0.5000A P:16.485W PF:1.0000 Freq:0Hz Lamp Flux:1475.17x1 lm		
NAME: XDL E4-WRA-L39030-50DW	TYPE:Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ108mm*H154mm	
MFR.: SBC XICATO CORP.		

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	15.1	15.9	15.3	16.1	16.2	12.0	12.8	12.2	13.0	13.1
3H	14.9	15.7	15.2	15.9	16.1	11.8	12.6	12.1	12.8	13.0
4H	14.9	15.6	15.1	15.8	16.0	11.8	12.5	12.0	12.7	12.9
6H	14.8	15.4	15.1	15.7	15.9	11.7	12.3	12.0	12.6	12.8
8H	14.7	15.4	15.0	15.6	15.9	11.6	12.3	11.9	12.5	12.8
12H	14.7	15.3	15.0	15.6	15.8	11.6	12.2	11.9	12.5	12.7
4H 2H	14.9	15.6	15.1	15.8	16.0	11.8	12.5	12.0	12.7	12.9
3H	14.7	15.3	15.0	15.6	15.8	11.6	12.2	11.9	12.5	12.7
4H	14.6	15.1	14.9	15.4	15.7	11.5	12.0	11.8	12.3	12.6
6H	14.5	15.0	14.9	15.3	15.6	11.4	11.9	11.8	12.2	12.5
8H	14.4	14.9	14.8	15.2	15.6	11.3	11.8	11.7	12.1	12.5
12H	14.4	14.8	14.8	15.2	15.6	11.3	11.7	11.7	12.1	12.5
8H 4H	14.4	14.9	14.8	15.2	15.6	11.3	11.8	11.7	12.1	12.5
6H	14.3	14.7	14.7	15.1	15.5	11.2	11.6	11.6	12.0	12.4
8H	14.3	14.6	14.7	15.0	15.5	11.2	11.5	11.6	11.9	12.4
12H	14.2	14.5	14.7	14.9	15.4	11.1	11.4	11.6	11.8	12.3
12H 4H	14.4	14.8	14.8	15.2	15.6	11.3	11.7	11.7	12.1	12.5
6H	14.3	14.6	14.7	15.0	15.5	11.2	11.5	11.6	11.9	12.4
8H	14.2	14.5	14.7	14.9	15.4	11.1	11.4	11.6	11.8	12.3
Variations with the observer position at spacings:										
S = 1.0H	+ 4.3 / -25.7					+ 3.0 / -24.0				
1.5H	+ 7.0 / -23.8					+ 5.7 / -21.0				
2.0H	+ 8.9 / -16.4					+ 7.2 / -12.0				

CIE Pub.117, 1475 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = 1.4)  
 Area: 0.00915624 m2

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2024-05-22

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
 Humidity:58%  
 Test Distance:9.016m [K=1.0000]  
 Remarks:

UTILIZATION FACTORS TABLE

Test:U:32.970V I:0.5000A P:16.485W PF:1.0000 Freq:0Hz Lamp Flux:1475.17x1 lm		
NAME: XDL E4-WRA-L39030-50DW	TYPE:Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ108mm*H154mm	
MFR.: SBC XICATO CORP.		


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	91	85	82	90	85	81	89	84	81	78
0.80	98	92	89	97	92	89	96	92	89	85
1.00	102	96	93	101	96	93	99	96	92	89
1.25	105	100	97	104	100	97	102	99	96	92
1.50	108	103	100	106	103	100	104	101	99	95
2.00	110	106	103	108	105	102	106	103	101	96
2.50	111	108	105	110	107	104	107	104	102	97
3.00	113	110	107	111	108	106	108	105	104	98
4.00	114	112	110	112	110	109	109	107	106	99
5.00	116	114	112	114	112	110	110	108	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended				SHRNOM = 1.25			

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2024-05-22

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
 Humidity:58%  
 Test Distance:9.016m [K=1.0000]  
 Remarks:

ISOCANDELA DIAGRAM

Test:U:32.970V I:0.5000A P:16.485W PF:1.0000 Freq:0Hz Lamp Flux:1475.17x1 lm		
NAME: XDL E4-WRA-L39030-50DW	TYPE:Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ108mm*H154mm	
MFR.: SBC XICATO CORP.		

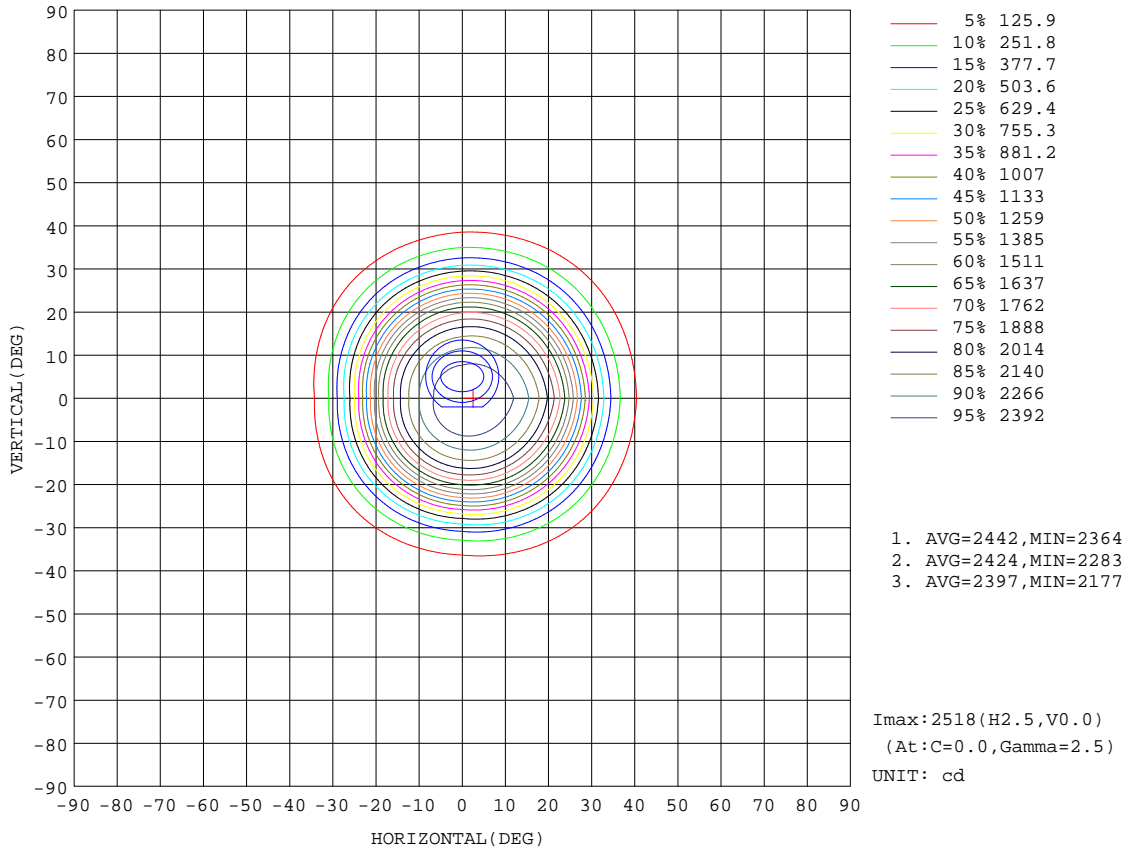

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature: 25.3DEG  
 Operators: Jasoan  
 Test Date: 2024-05-22


γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System: EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
 Humidity: 58%  
 Test Distance: 9.016m [K=1.0000]  
 Remarks:



AAI Figure

Test:U:32.970V I:0.5000A P:16.485W PF:1.0000 Freq:0Hz Lamp Flux:1475.17x1 lm		
NAME: XDL E4-WRA-L39030-50DW	TYPE:Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ108mm*H154mm	
MFR.: SBC XICATO CORP.		

Flux out:1053 lm

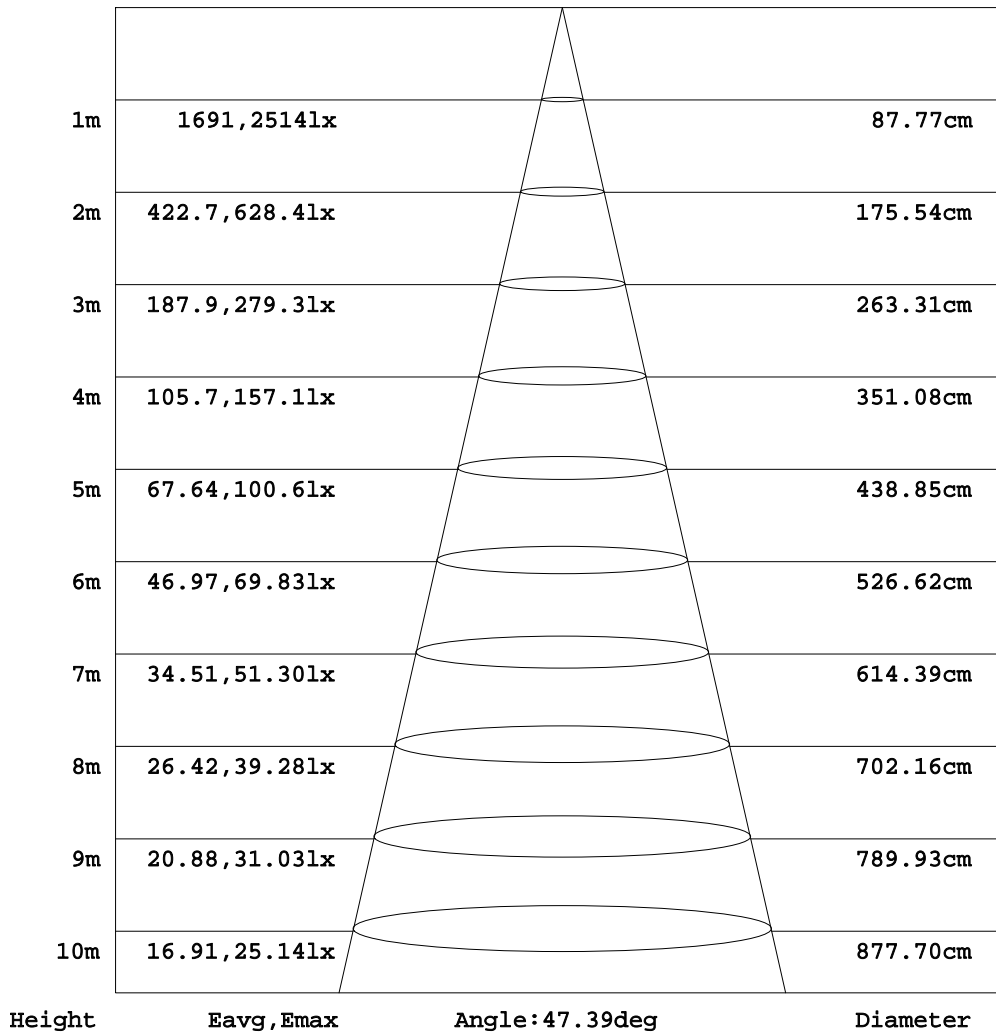


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2024-05-22

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
 Humidity:58%  
 Test Distance:9.016m [K=1.0000]  
 Remarks:

ISOLUX DIAGRAM

Test:U:32.970V I:0.5000A P:16.485W PF:1.0000 Freq:0Hz Lamp Flux:1475.17x1 lm		
NAME: XDL E4-WRA-L39030-50DW	TYPE:Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ108mm*H154mm	
MFR.: SBC XICATO CORP.		

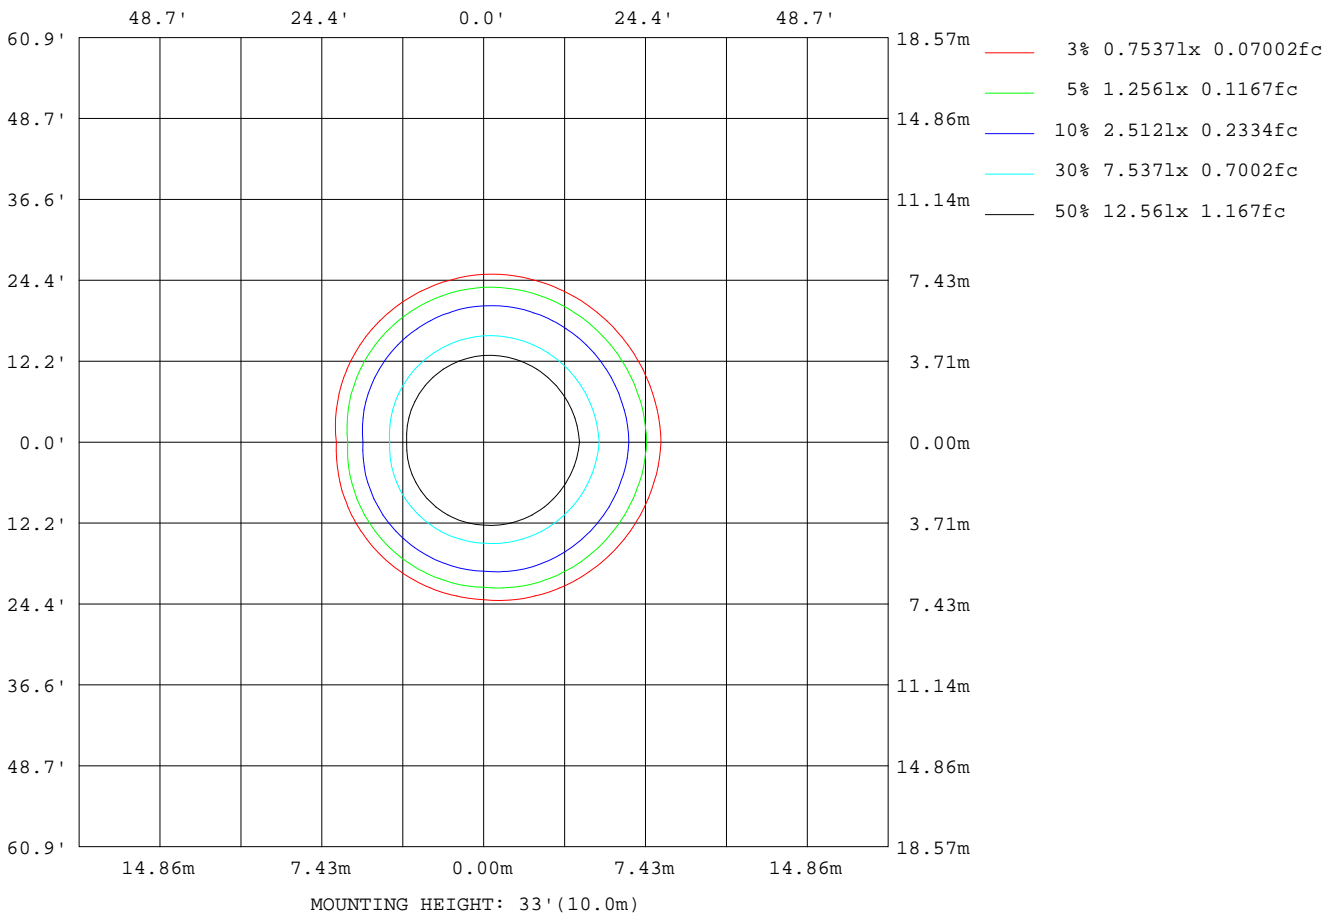

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2024-05-22

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
 Humidity:58%  
 Test Distance:9.016m [K=1.0000]  
 Remarks:

LED Avg.L Report

Test:U:32.970V I:0.5000A P:16.485W PF:1.0000 Freq:0Hz Lamp Flux:1475.17x1 lm		
NAME: XDL E4-WRA-L39030-50DW	TYPE:Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ108mm*H154mm	
MFR.: SBC XICATO CORP.		


AvgL	cd/m2
L_0~180 (65) av	61
L_0~180 (75) av	25
L_0~180 (85) av	60
L_90~270 (65) av	58
L_90~270 (75) av	19
L_90~270 (85) av	56
L_45 (65) av	56
L_45 (75) av	21
L_45 (85) av	57

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2024-05-22

γ Range: 0 - 90DEG  
 γ Interval: 0.5DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
 Humidity:58%  
 Test Distance:9.016m [K=1.0000]  
 Remarks:

Planar Illuminance Curve

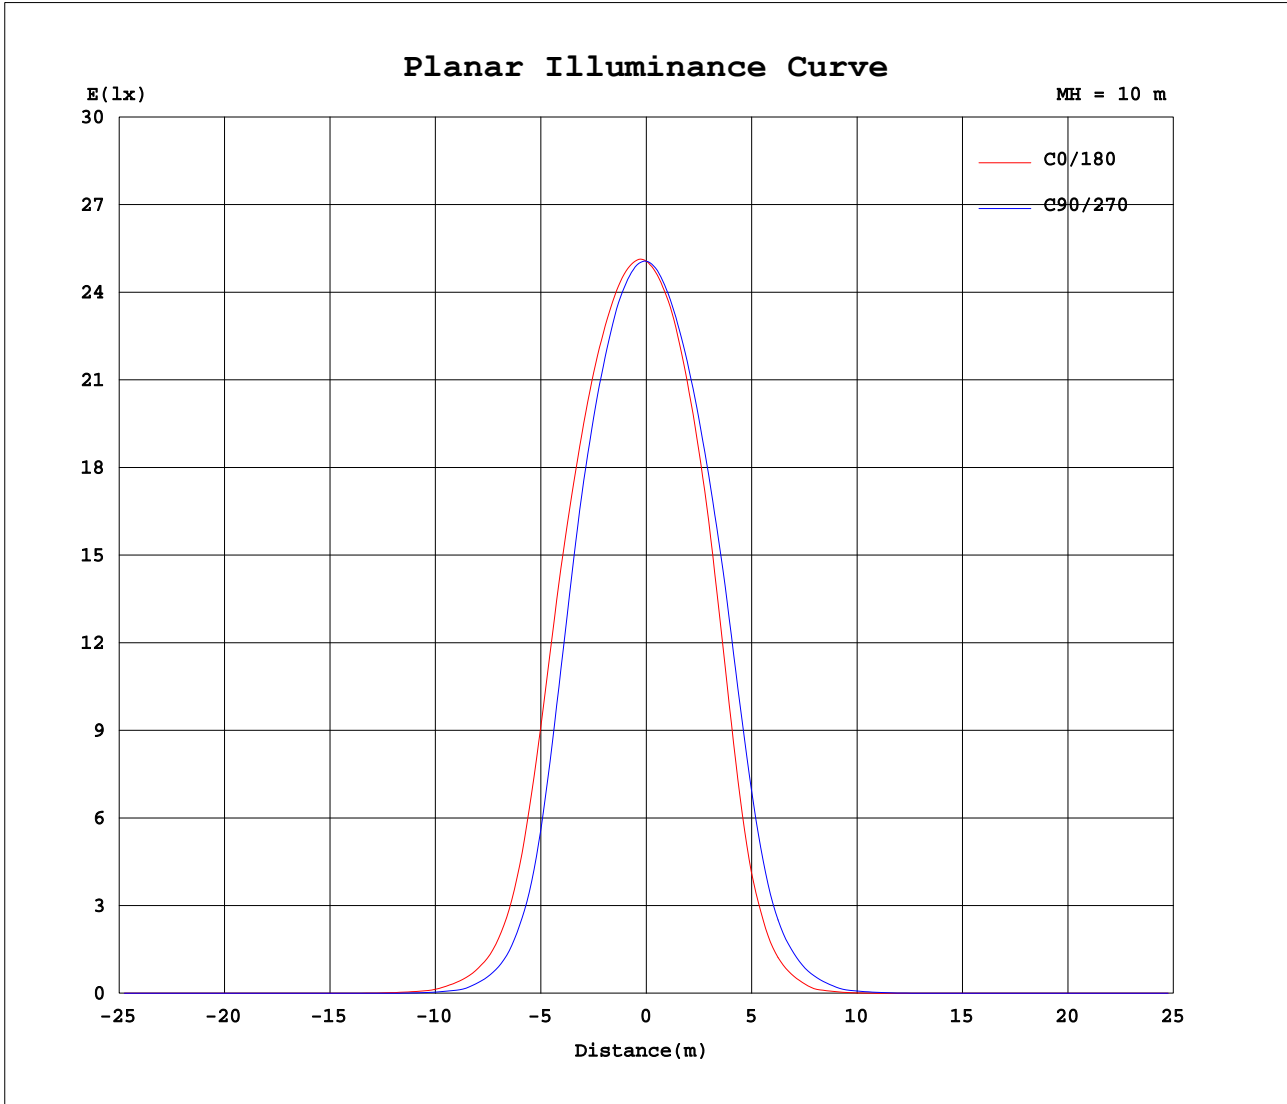

C Range: 0 - 360DEG  
C Interval: 90.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: Jasoan  
Test Date: 2024-05-22

γ Range: 0 - 90DEG  
γ Interval: 0.5DEG  
Test System: EVERFINE GO-2000A\_V1 SYSTEM V2.00.421  
Humidity: 58%  
Test Distance: 9.016m [K=1.0000]  
Remarks:

