
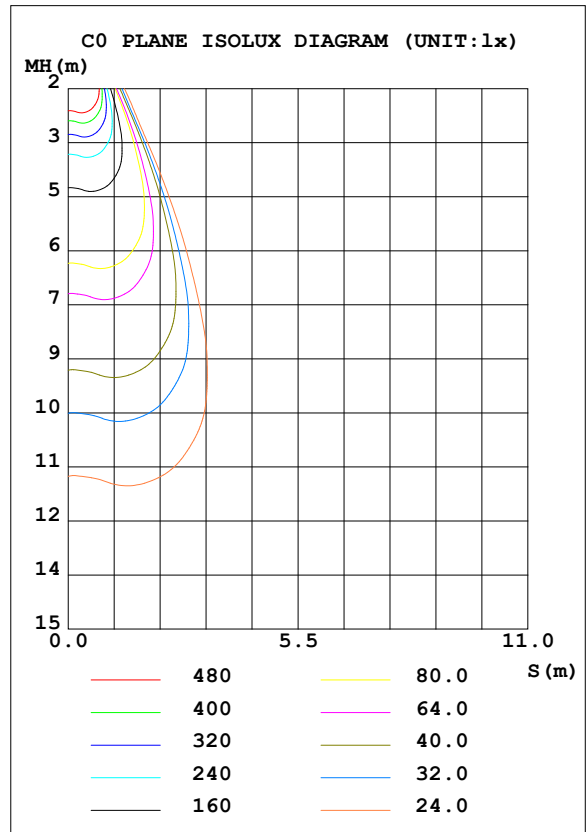


**LUMINAIRE PHOTOMETRIC TEST REPORT**

Test:U:33.400V I:0.4990A P:16.667W PF:1.0000 Freq:0Hz Lamp Flux:1840.5x1 lm		
NAME: XDL E6-WRA-L29030-50DW	TYPE: Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ162mm*H188mm	
MFR.: SBC XICATO CORP.		

DATA OF LAMP		PHOTOMETRIC DATA Eff: 110.43 lm/W			
MODEL	XOB CRI 90 3000K	I <sub>max</sub> (cd)	3373	S/MH (C0/180)	0.70
NOMINAL POWER (W)	17	LOR (%)	100.0	S/MH (C90/270)	0.67
RATED VOLTAGE (V)	37	TOTAL FLUX (lm)	1840.5	η UP, DN (C0-180)	0.0, 51.4
NOMINAL FLUX (lm)	1840.5	CIE CLASS	DIRECT	η UP, DN (C180-360)	0.0, 48.6
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.50
TEST VOLTAGE (V)	33.4	η down (%)	100.0	CIBSE SHR MAX	0.50

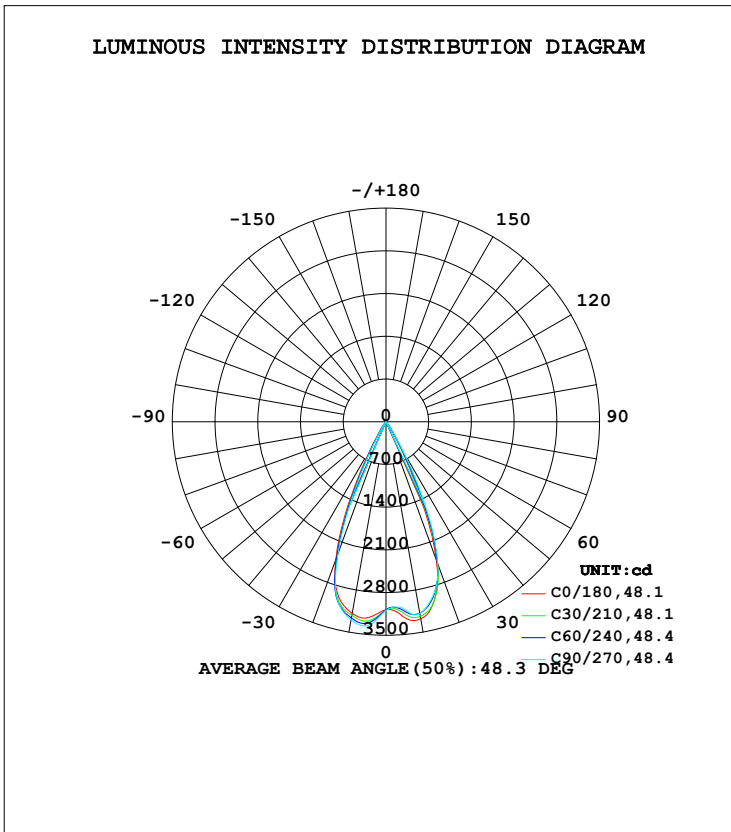

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: MEDIUM  
Temperature: 25.3DEG  
Operators: Jasoan  
Test Date: 2024-10-11

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System: EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
Humidity: 58%  
Test Distance: 9.322m [K=1.0000]  
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	3279	3212	3189	3171	3189	3244	3298	3312	0- 10	308.1	308.1	16.7,16.7
20	2416	2472	2478	2455	2413	2355	2306	2342	10- 20	824.3	1132	61.5,61.5
30	396.0	489.5	578.5	542.6	457.2	380.1	317.7	334.0	20- 30	603.9	1736	94.3,94.3
40	29.08	35.49	39.59	41.58	35.72	29.01	23.70	23.43	30- 40	94.80	1831	99.5,99.5
50	1.421	1.552	2.115	2.269	2.132	1.417	1.178	1.162	40- 50	8.370	1840	99.9,99.9
60	0.3254	0.2731	0.3035	0.3665	0.2826	0.2661	0.2837	0.2729	50- 60	0.6833	1840	100,100
70	0.1245	0.0865	0.0691	0.1037	0.0828	0.0899	0.1107	0.0968	60- 70	0.1532	1840	100,100
80	0.0829	0.0726	0.0691	0.0726	0.0691	0.0691	0.0760	0.0761	70- 80	0.0819	1840	100,100
90	0.0760	0.0691	0.0691	0.0760	0.0691	0.0691	0.0760	0.0760	80- 90	0.0798	1841	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1837.7 lm

%lum = 99.8%  
%lamp = 99.8%

Conical surface Flux(120deg): 1840.2 lm

%lum = 100.0%  
%lamp = 100.0%

0 - 45 DEG Zonal Flux:1837.7 %lum: 99.8%  
135 - 180 DEG Zonal Flux:0 %lum: 0.0%


All measured values may vary less than 35 %  
from the average measured value in the 0 to 130 deg. zone: 3.7%  
All measured values in the 0 to 130 deg. zone  
may vary less than 50% from the average value of itself: 5.5%

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:Jasoan  
Test Date:2024-10-11

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
Humidity:58%  
Test Distance:9.322m [K=1.0000]  
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:33.400V I:0.4990A P:16.667W PF:1.0000 Freq:0Hz Lamp Flux:1840.5x1 lm		
NAME: XDL E6-WRA-L29030-50DW	TYPE: Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ162mm*H188mm	
MFR.: SBC XICATO CORP.		

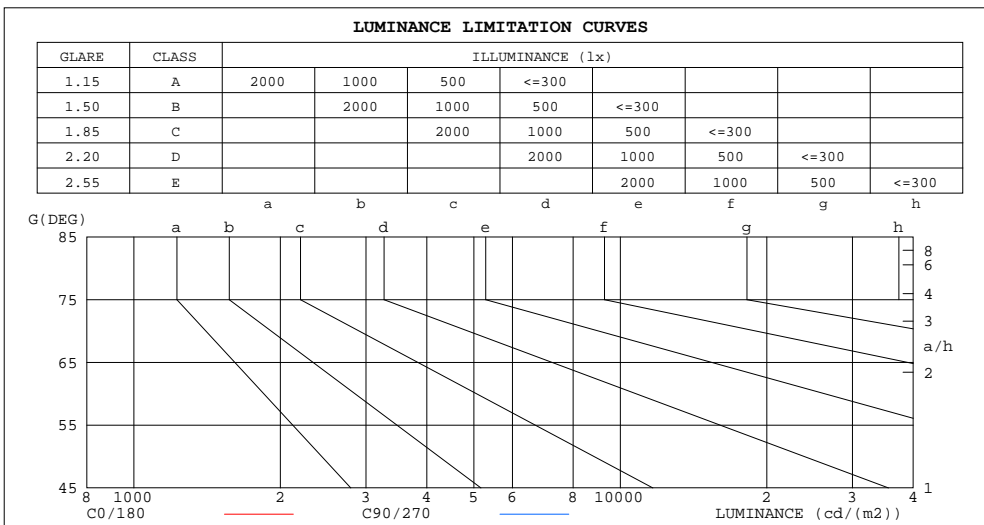

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	46	38
80	23	19
75	17	13
70	18	10
65	20	12
60	32	29
55	62	68
50	107	160
45	502	724


C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: MEDIUM  
 Temperature: 25.3DEG  
 Operators: Jasoan  
 Test Date: 2024-10-11

γ Range: 0 - 90DEG  
 γ Interval: 1.0DEG  
 Test System: EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
 Humidity: 58%  
 Test Distance: 9.322m [K=1.0000]  
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:33.400V I:0.4990A P:16.667W PF:1.0000 Freq:0Hz Lamp Flux:1840.5x1 lm		
NAME: XDL E6-WRA-L29030-50DW	TYPE: Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: $\phi$ 162mm*H188mm	
MFR.: SBC XICATO CORP.		

pcc	80%			70%			50%			30%			10%			0
	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pw																0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio      Coefficients of Utilization(CU)															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.12	1.10	1.08	1.10	1.08	1.06	1.06	1.04	1.03	1.02	1.01	1.00	.99	.98	.97	.95
2.0	1.06	1.03	.90	1.04	1.01	.99	1.01	.99	.96	.98	.96	.94	.95	.94	.92	.91
3.0	1.00	.96	.93	.99	.95	.92	.97	.93	.91	.94	.92	.89	.92	.90	.88	.87
4.0	.95	.91	.87	.94	.90	.87	.92	.89	.86	.90	.87	.85	.89	.86	.84	.83
5.0	.91	.86	.83	.90	.86	.82	.88	.84	.82	.87	.83	.81	.85	.82	.80	.79
6.0	.87	.82	.78	.86	.81	.78	.85	.81	.78	.83	.80	.77	.82	.79	.77	.75
7.0	.83	.78	.75	.82	.78	.74	.81	.77	.74	.80	.76	.74	.79	.76	.73	.72
8.0	.79	.74	.71	.79	.74	.71	.78	.74	.71	.77	.73	.70	.76	.73	.70	.69
9.0	.76	.71	.68	.76	.71	.68	.75	.71	.68	.74	.70	.67	.73	.70	.67	.66
10.0	.73	.68	.65	.73	.68	.65	.72	.68	.65	.71	.67	.65	.71	.67	.64	.63

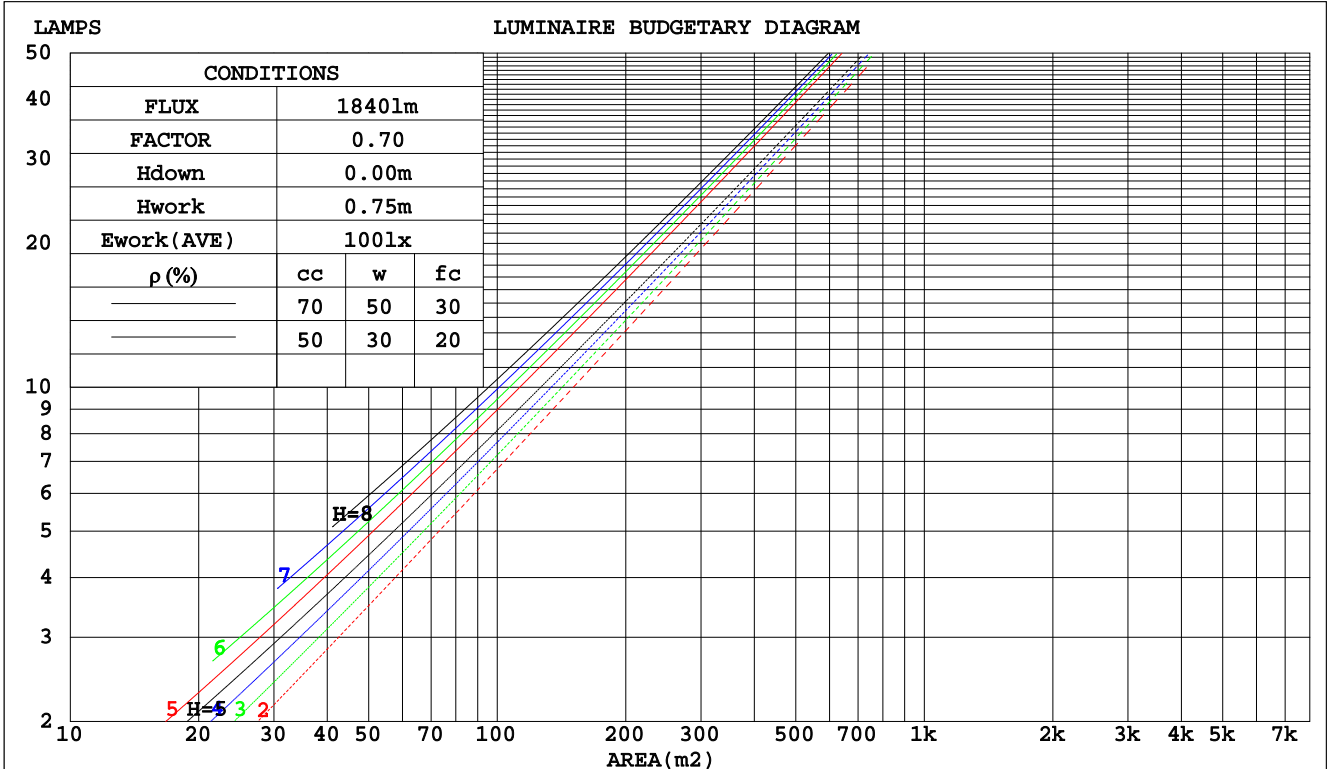

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: MEDIUM  
 Temperature: 25.3DEG  
 Operators: Jasoan  
 Test Date: 2024-10-11

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System: EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
 Humidity: 58%  
 Test Distance: 9.322m [K=1.0000]  
 Remarks:

WEC AND CCEC

Test:U:33.400V I:0.4990A P:16.667W PF:1.0000 Freq:0Hz Lamp Flux:1840.5x1 lm		
NAME: XDL E6-WRA-L29030-50DW	TYPE: Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ162mm*H188mm	
MFR.: SBC XICATO CORP.		

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.153	.087	.027	.146	.083	.026	.134	.077	.024	.122	.070	.023	.111	.065	.021	
2.0	.143	.079	.024	.138	.076	.023	.127	.071	.022	.118	.066	.021	.109	.062	.019	
3.0	.135	.072	.022	.131	.070	.021	.122	.066	.020	.114	.062	.019	.106	.059	.018	
4.0	.128	.067	.020	.124	.065	.019	.117	.062	.018	.110	.059	.018	.103	.056	.017	
5.0	.122	.062	.018	.118	.061	.018	.112	.058	.017	.106	.056	.017	.100	.054	.016	
6.0	.116	.058	.017	.113	.057	.016	.108	.055	.016	.102	.053	.016	.097	.051	.015	
7.0	.111	.055	.016	.108	.054	.015	.104	.052	.015	.099	.051	.015	.095	.049	.014	
8.0	.106	.052	.015	.104	.051	.015	.100	.050	.014	.096	.049	.014	.092	.047	.014	
9.0	.102	.050	.014	.100	.049	.014	.096	.048	.014	.093	.047	.013	.089	.045	.013	
10.0	.099	.047	.013	.097	.047	.013	.093	.046	.013	.090	.045	.013	.087	.044	.013	

ρcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.169	.158	.147	.145	.135	.126	.099	.093	.087	.057	.054	.051	.018	.017	.016	
2.0	.152	.133	.116	.131	.114	.100	.089	.079	.070	.052	.046	.041	.017	.015	.013	
3.0	.139	.113	.093	.119	.098	.081	.082	.068	.057	.047	.040	.033	.015	.013	.011	
4.0	.127	.098	.076	.109	.085	.066	.075	.059	.047	.043	.035	.028	.014	.011	.009	
5.0	.117	.086	.063	.101	.075	.055	.069	.052	.039	.040	.031	.023	.013	.010	.008	
6.0	.109	.077	.053	.094	.066	.046	.065	.046	.033	.038	.027	.019	.012	.009	.006	
7.0	.102	.069	.045	.088	.060	.039	.061	.042	.028	.035	.025	.017	.011	.008	.005	
8.0	.096	.062	.039	.083	.054	.034	.057	.038	.024	.033	.022	.014	.011	.007	.005	
9.0	.091	.057	.034	.078	.049	.029	.054	.035	.021	.032	.020	.012	.010	.007	.004	
10.0	.087	.052	.029	.075	.045	.026	.052	.032	.018	.030	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: MEDIUM  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2024-10-11

γ Range: 0 - 90DEG  
 γ Interval: 1.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
 Humidity:58%  
 Test Distance:9.322m [K=1.0000]  
 Remarks:

UGR(Unified Glare Rating) Table

Test:U:33.400V I:0.4990A P:16.667W PF:1.0000 Freq:0Hz Lamp Flux:1840.5x1 lm		
NAME: XDL E6-WRA-L29030-50DW	TYPE: Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ162mm*H188mm	
MFR.: SBC XICATO CORP.		

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	3.7	4.5	3.9	4.6	4.8	4.5	5.2	4.7	5.4	5.6
3H	3.5	4.3	3.8	4.4	4.6	4.3	5.0	4.6	5.2	5.4
4H	3.5	4.1	3.7	4.3	4.6	4.2	4.9	4.5	5.1	5.3
6H	3.4	4.0	3.7	4.2	4.5	4.1	4.8	4.4	5.0	5.3
8H	3.3	3.9	3.6	4.2	4.4	4.1	4.7	4.4	5.0	5.2
12H	3.3	3.9	3.6	4.1	4.4	4.1	4.6	4.4	4.9	5.2
4H 2H	3.5	4.1	3.7	4.3	4.6	4.2	4.9	4.5	5.1	5.3
3H	3.3	3.9	3.6	4.1	4.4	4.1	4.6	4.4	4.9	5.2
4H	3.2	3.7	3.5	4.0	4.3	4.0	4.5	4.3	4.8	5.1
6H	3.1	3.6	3.5	3.9	4.2	3.9	4.3	4.2	4.7	5.0
8H	3.0	3.5	3.4	3.8	4.2	3.8	4.2	4.2	4.6	5.0
12H	3.0	3.4	3.4	3.8	4.1	3.8	4.2	4.2	4.5	4.9
8H 4H	3.0	3.5	3.4	3.8	4.2	3.8	4.2	4.2	4.6	5.0
6H	2.9	3.3	3.4	3.7	4.1	3.7	4.1	4.1	4.5	4.9
8H	2.9	3.2	3.3	3.6	4.0	3.6	4.0	4.1	4.4	4.8
12H	2.8	3.1	3.3	3.5	4.0	3.6	3.9	4.0	4.3	4.8
12H 4H	3.0	3.4	3.4	3.8	4.1	3.8	4.2	4.2	4.5	4.9
6H	2.9	3.2	3.3	3.6	4.0	3.6	4.0	4.1	4.4	4.8
8H	2.8	3.1	3.3	3.5	4.0	3.6	3.9	4.0	4.3	4.8
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 4.4 / -19.5					+ 5.0 / -20.8				
1.5H	+ 7.1 / -17.6					+ 7.7 / -18.4				
2.0H	+ 7.6 / - 9.4					+ 8.5 / -10.8				

CIE Pub.117, 1841 lm Total Lamp Luminous Flux Correct (8log(F/F0) = 2.1)  
Area: 0.0206015 m2

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:Jasoan  
Test Date:2024-10-11

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
Humidity:58%  
Test Distance:9.322m [K=1.0000]  
Remarks:

UTILIZATION FACTORS TABLE

Test:U:33.400V I:0.4990A P:16.667W PF:1.0000 Freq:0Hz Lamp Flux:1840.5x1 lm		
NAME: XDL E6-WRA-L29030-50DW	TYPE: Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ162mm*H188mm	
MFR.: SBC XICATO CORP.		


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
k = 0.60	91	86	82	91	85	82	90	85	82	79
0.80	98	93	90	98	93	90	96	92	89	86
1.00	102	97	94	101	97	93	100	96	93	89
1.25	105	101	98	104	100	97	103	99	97	93
1.50	108	104	101	107	103	100	104	101	99	95
2.00	110	106	103	109	105	103	106	103	101	96
2.50	111	108	105	110	107	104	107	104	103	97
3.00	113	110	107	111	108	106	108	106	104	98
4.00	115	112	110	113	111	109	109	107	106	99
5.00	116	114	112	114	112	111	110	109	107	100
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004			Suspended				SHRNOM = 1.25			

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: MEDIUM  
 Temperature:25.3DEG  
 Operators:Jasoan  
 Test Date:2024-10-11

γ Range: 0 - 90DEG  
 γ Interval: 1.0DEG  
 Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
 Humidity:58%  
 Test Distance:9.322m [K=1.0000]  
 Remarks:

ISOCANDELA DIAGRAM

Test:U:33.400V I:0.4990A P:16.667W PF:1.0000 Freq:0Hz Lamp Flux:1840.5x1 lm		
NAME: XDL E6-WRA-L29030-50DW	TYPE: Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ162mm*H188mm	
MFR.: SBC XICATO CORP.		

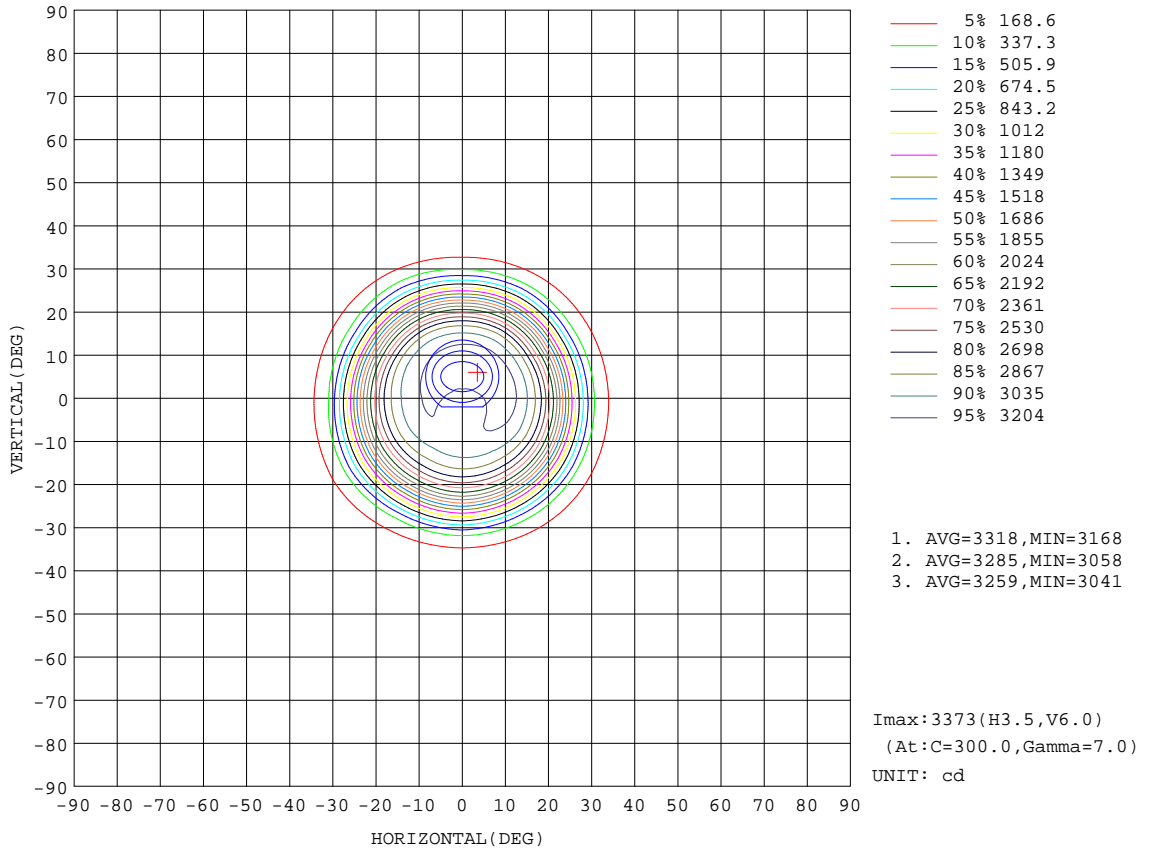

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: MEDIUM  
 Temperature: 25.3DEG  
 Operators: Jasoan  
 Test Date: 2024-10-11


γ Range: 0 - 90DEG  
 γ Interval: 1.0DEG  
 Test System: EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
 Humidity: 58%  
 Test Distance: 9.322m [K=1.0000]  
 Remarks:



AAI Figure

Test:U:33.400V I:0.4990A P:16.667W PF:1.0000 Freq:0Hz Lamp Flux:1840.5x1 lm		
NAME: XDL E6-WRA-L29030-50DW	TYPE: Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ162mm*H188mm	
MFR.: SBC XICATO CORP.		

Flux out:1526 lm

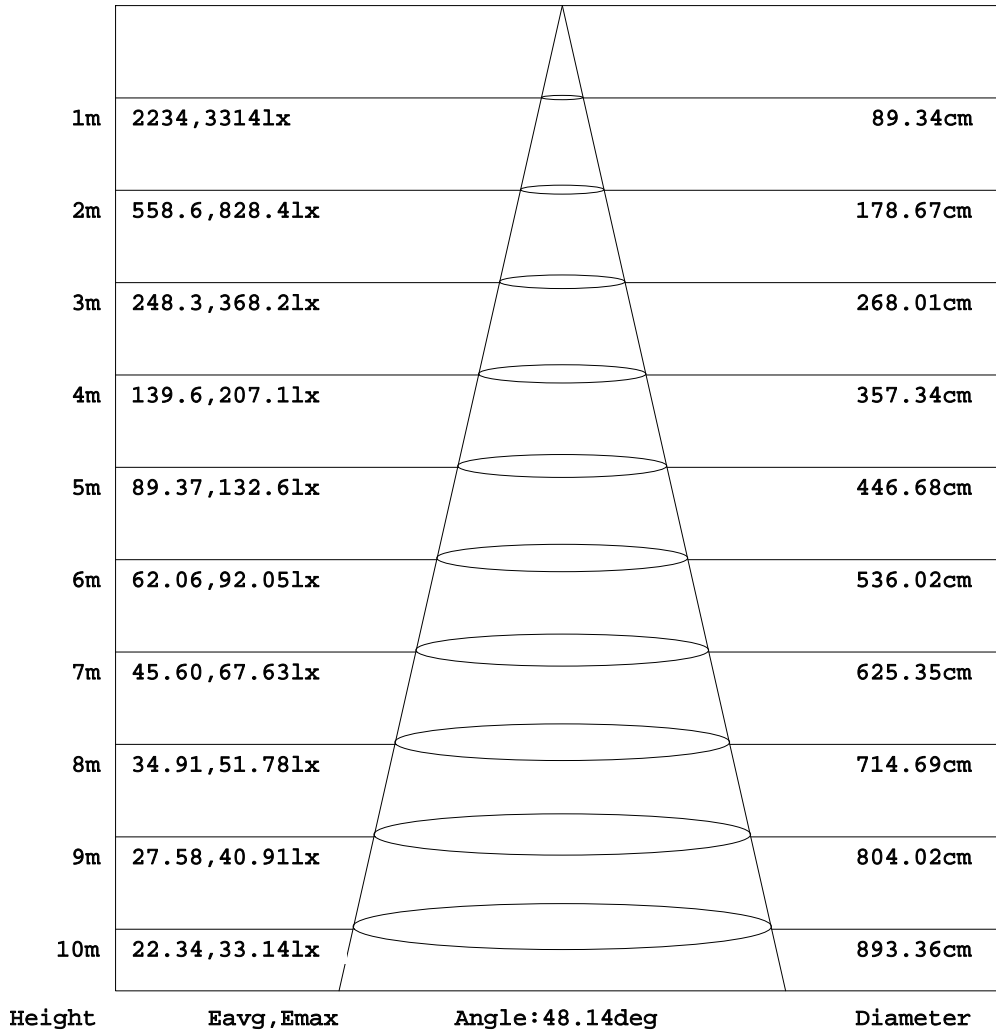


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:Jasoan  
Test Date:2024-10-11

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
Humidity:58%  
Test Distance:9.322m [K=1.0000]  
Remarks:

ISOLUX DIAGRAM

Test:U:33.400V I:0.4990A P:16.667W PF:1.0000 Freq:0Hz Lamp Flux:1840.5x1 lm		
NAME: XDL E6-WRA-L29030-50DW	TYPE: Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: $\phi$ 162mm*H188mm	
MFR.: SBC XICATO CORP.		

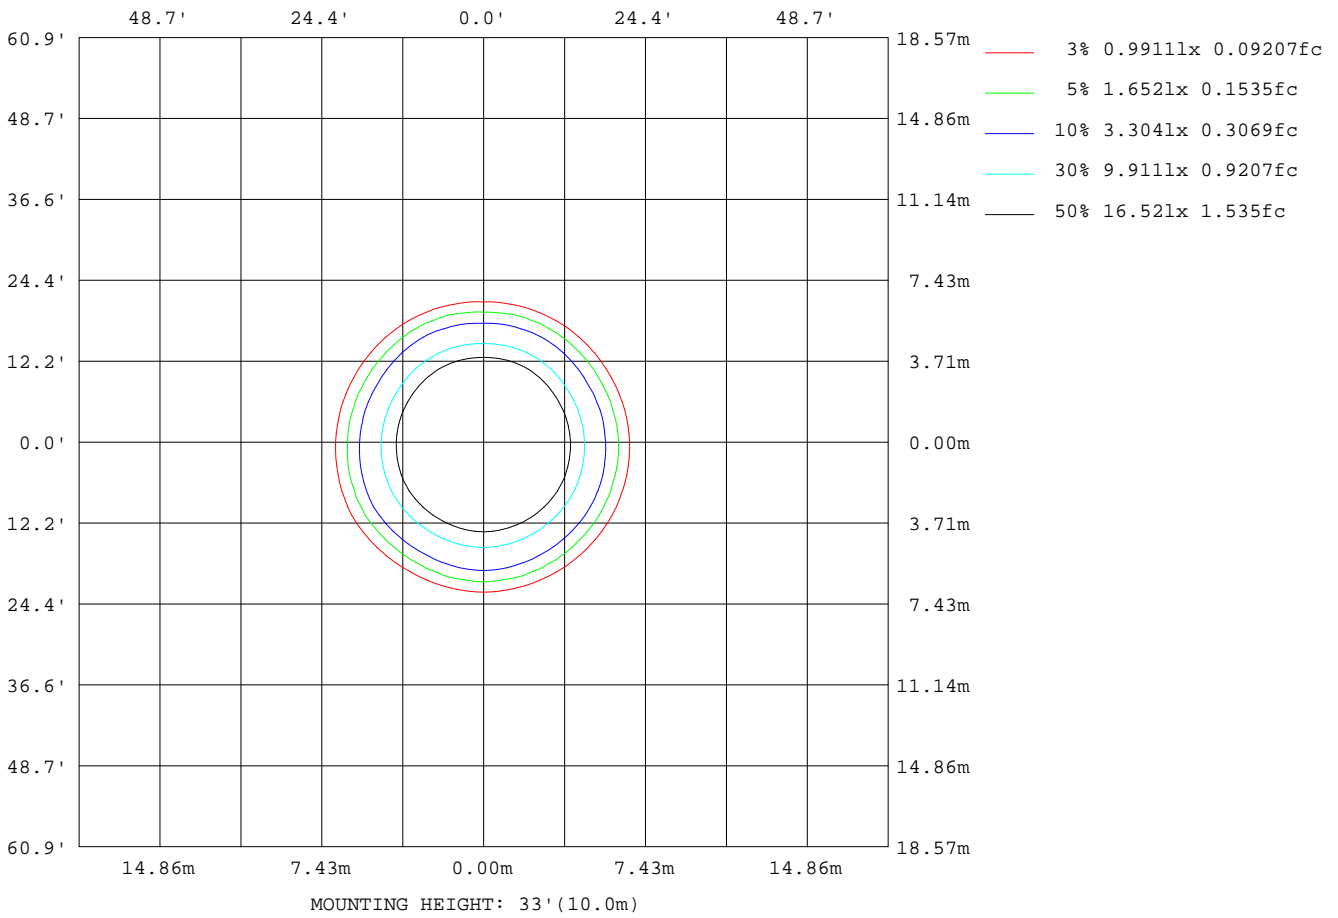

C Range: 0 - 360DEG  
 C Interval: 30.0DEG  
 Test Speed: MEDIUM  
 Temperature: 25.3DEG  
 Operators: Jasoan  
 Test Date: 2024-10-11

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System: EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
 Humidity: 58%  
 Test Distance: 9.322m [K=1.0000]  
 Remarks:

LED Avg.L Report

Test:U:33.400V I:0.4990A P:16.667W PF:1.0000 Freq:0Hz Lamp Flux:1840.5x1 lm		
NAME: XDL E6-WRA-L29030-50DW	TYPE: Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ162mm*H188mm	
MFR.: SBC XICATO CORP.		


AvgL	cd/m2
L_0~180 (65) av	16
L_0~180 (75) av	15
L_0~180 (85) av	42
L_90~270 (65) av	15
L_90~270 (75) av	14
L_90~270 (85) av	40
L_45 (65) av	15
L_45 (75) av	14
L_45 (85) av	40

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:Jasoan  
Test Date:2024-10-11

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
Humidity:58%  
Test Distance:9.322m [K=1.0000]  
Remarks:

Planar Illuminance Curve

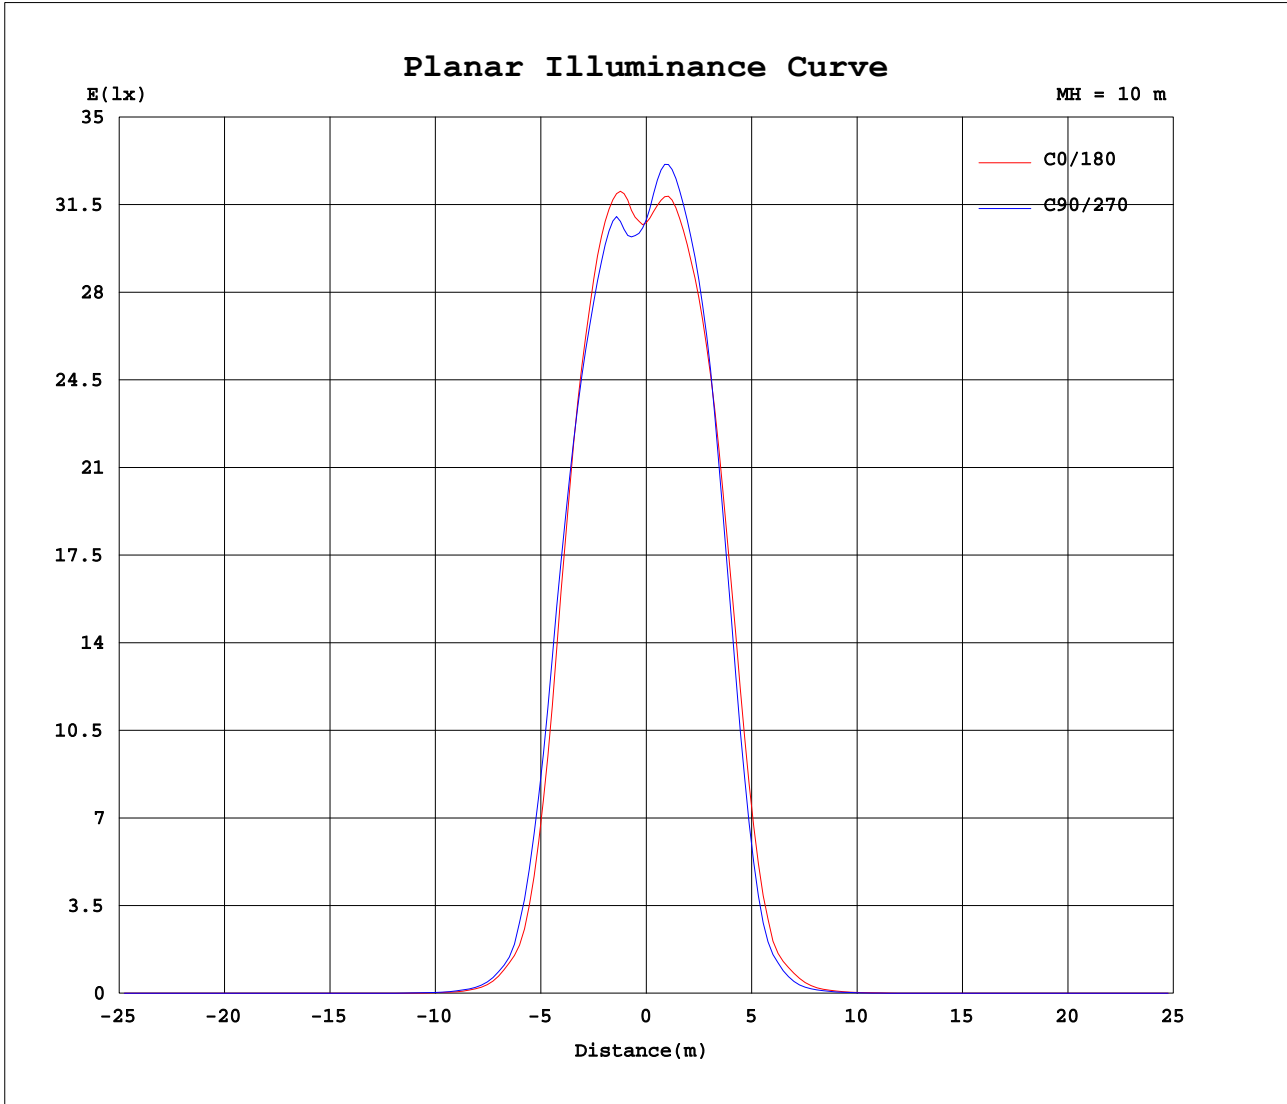

C Range: 0 - 360DEG  
C Interval: 30.0DEG  
Test Speed: MEDIUM  
Temperature: 25.3DEG  
Operators: Jasoan  
Test Date: 2024-10-11

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System: EVERFINE GO-2000A\_V1 SYSTEM V2.00.444  
Humidity: 58%  
Test Distance: 9.322m [K=1.0000]  
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Test:U:33.400V I:0.4990A P:16.667W PF:1.0000 Freq:0Hz Lamp Flux:1840.5x1 lm		
NAME: XDL E6-WRA-L29030-50DW	TYPE: Downlight	SERIAL No.:
SPEC.: XOB CRI 90 3000K	DIM.: φ162mm*H188mm	
MFR.: SBC XICATO CORP.		

Table--1

UNIT: cd

C (DEG) γ (DEG)	0	30	60	90	120	150	180	210	240	270	300	330						
0	3078	3085	3079	3090	3083	3089	3078	3085	3079	3090	3083	3089						
5	3205	3136	3094	3062	3097	3157	3218	3273	3309	3349	3347	3304						
10	3279	3238	3186	3189	3162	3180	3189	3222	3266	3298	3316	3308						
15	3043	3043	2981	2962	2944	2985	2984	3024	3053	3048	3064	3035						
20	2416	2478	2466	2478	2450	2460	2413	2355	2354	2306	2351	2332						
25	1272	1400	1456	1533	1470	1486	1376	1249	1223	1158	1203	1179						
30	396	476	503	578	523	562	457	371	389	318	336	332						
35	125	141	149	157	150	168	147	121	104	86.3	91.8	103						
40	29.1	34.7	36.3	39.6	40.8	42.4	35.7	30.4	27.6	23.7	23.6	23.3						
45	7.32	8.35	8.99	10.5	11.0	11.8	10.7	9.20	8.33	7.07	6.63	6.19						
50	1.42	1.48	1.63	2.12	2.15	2.39	2.13	1.58	1.25	1.18	1.17	1.16						
55	0.73	0.69	0.77	0.81	0.89	0.84	0.72	0.71	0.61	0.65	0.64	0.65						
60	0.33	0.23	0.31	0.30	0.39	0.34	0.28	0.32	0.21	0.28	0.26	0.29						
65	0.17	0.08	0.15	0.10	0.18	0.13	0.10	0.17	0.08	0.16	0.12	0.16						
70	0.12	0.07	0.10	0.07	0.13	0.08	0.08	0.11	0.07	0.11	0.08	0.12						
75	0.09	0.07	0.08	0.07	0.08	0.07	0.07	0.08	0.07	0.08	0.08	0.08						
80	0.08	0.07	0.08	0.07	0.08	0.07	0.07	0.07	0.07	0.08	0.08	0.08						
85	0.08	0.07	0.08	0.07	0.08	0.07	0.07	0.07	0.07	0.08	0.08	0.08						
90	0.08	0.07	0.07	0.07	0.08	0.08	0.07	0.07	0.07	0.08	0.08	0.08						

C Range: 0 - 360DEG	γ Range: 0 - 90DEG
C Interval: 30.0DEG	γ Interval: 1.0DEG
Test Speed: MEDIUM	Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.444
Temperature:25.3DEG	Humidity:58%
Operators:Jasoan	Test Distance:9.322m [K=1.0000]
Test Date:2024-10-11	Remarks: